


NOTES:

1. Maximum spans shall be based on an effective LVL depth of 9".
2. Notch shall be on the top of the beam
3. On center spacing between notches shall not be less than 32" c/c.

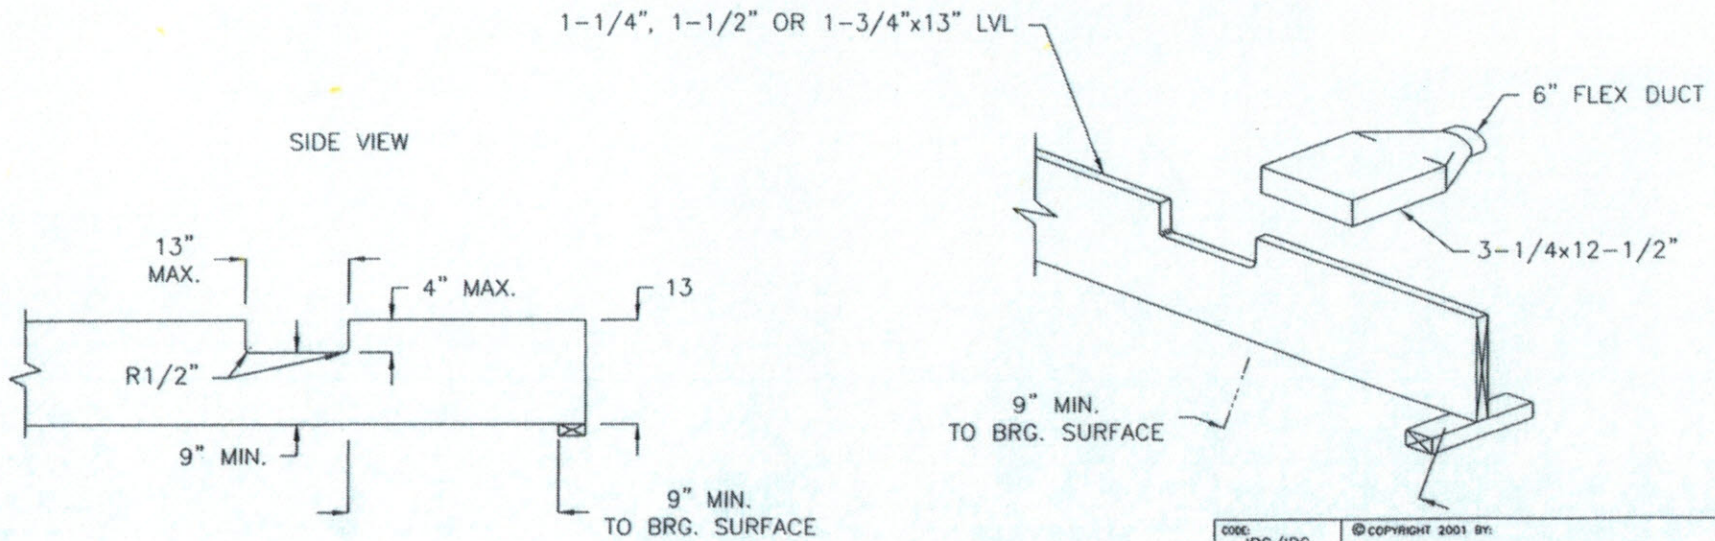

CUT OUT DETAIL FOR AN LVL BEAM
TO ALLOW FOR DUCT CLEARANCE.

CODE: IBC/IRC	© COPYRIGHT 2001 BY:	
DATE DRAWN: 4/22/2002		
DRAWN BY: BR	DRAWN FOR ENGINEERING	MFG. PLANT #: 200
APPROVED BY: 	DRWG. NO. D8666R01	JOB NUMBER: 19043
SCALE: N.T.S.	PLANT DESIGN ID:	
DO NOT SCALE DRAWING FOR DIMENSIONS		